

TESTRAPPORT
57226/1
ENGLISH TRANSLATION


According to EN 13030: 2001: "Ventilation of buildings - Grilles - Performance testing of air grilles subjected to simulated rain"

**Weather Louvre Test
 412 [mesh 2,3] with
 drain profile**

carried out by : BSRIA Ltd
 Old Bracknell West, Bracknell
 Berkshire RG12 7AH [Engeland]

commissioned by : nv RENSON Sunprotection-Projects sa
 Maalbeekstraat 10
 8790 Waregem [België]

Date of issue : 18 December 2015

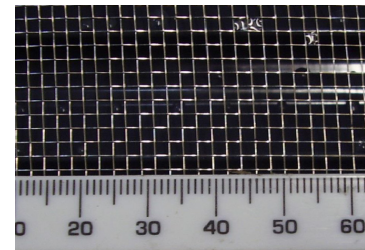

Close-up of guard

TEST INFORMATION

Contract	59126
Date	5-10-15
Manufacturer	nv RENSON Sunprotection-Projects sa
Louvre Model	412 [mesh 2,3] with drain profile
Material	Aluminium
Painted	Yes - dark grey
Blade Height	986 mm
Blade Width	1000 mm
Blade Depth	25 mm
Frame Depth	30 mm
No. of Blades	47
Blade Pitch	20 mm
Blade Angle	45° approx.
No. of Banks	2
Guard Type	Insect
Guard Spacing	5 mm
Side Channels	No
Water Drip Tray	Yes
Blade Orientation	Horizontal



59126A2 [front]



59126A2 [back]

INTRODUCTION


This report concerns tests conducted on a louvre to determine the Rainwater Penetration and the Pressure Drop versus Airflow Curve, with the associated Coefficient of Entry using the test methods contained within EN 13030 : 2001. The work was commissioned by nv RENSON Ventilation sa and was carried out at BSRIA on 14 – 31 May 2013.

Items received for test

Test Item	BSRIA ID
412 [mesh 2.3mm] without drain profile	59126A2

TEST METHOD

A schematic representation of the rig used during testing

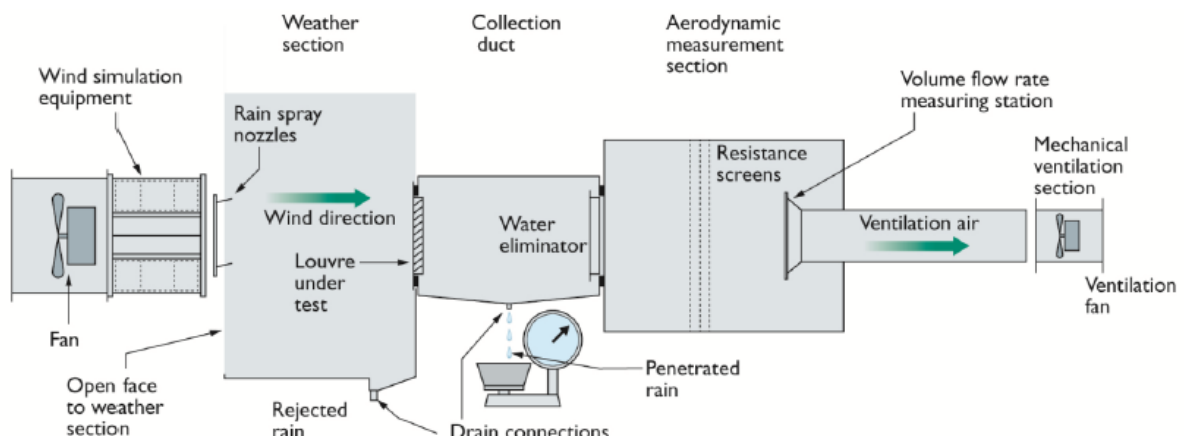

The test comprises of two parts:

- **WATER PENETRATION**

The weather louvre is subjected to fan driven wind at a speed of 13 m/s and water sprayed as rainfall at a rate of 75 l/h. In addition to the simulated wind and rain, air is drawn through the louvre at various set velocities [0, 0.5, 1.0, 1.5, 2.0, 2.5, 3.0 and 3.5 m/s].

Each test is preceded by a suitable 'pre-test' soak which is typically around 30 minutes. Each test is run until the results become stable, and in any case, for a minimum of 30 minutes.

The penetrated water is collected in the collection duct and is measured and recorded against time elapsed.

A range of measurements are taken to give the characteristic curve for the test louvre.

- **PRESSURE DROP**

For this test, the Aerodynamic Measuring Section [AMS] is separated from the main rig. The louvre is then mounted in the upstream opening of the AMS.

Pressure tappings in the plenum walls of the AMS allow measurement of the static pressure within the plenum during testing. The airflow volume is calculated from the differential pressure at the measuring cones. The plenum has a set of settling screens within to produce even flow through the cones and therefore give accurate reading of the total volume.

By adjusting the fan speed, the total airflow through the system varies and therefore changes the pressure on the louvre under test. A range of measurements are taken to give the characteristic curve for the test louvre.

- **TEST EQUIPMENT USED**

Test equipment	BSRIA ID	Calibration Expiry Date
Water supply measurement	352	9-1-16
Rain measuring system	353	9-1-16
Airflow cones	364	9-1-16
Micromanometer	5	17-2-16
Micromanometer	682	7-1-16
Scales [water]	332	9-2-16

WEATHER LOUVRE TEST

Uitgevoerd in opdracht van nv RENSON Sunprotection-Projects sa
Industriezone 2
Vijverdam
Maalbeekstraat 10
8790 Waregem
België

Contract : Report 59126/2

Datum : 18 December 2015

Door : BSRIA Ltd
Old Bracknell Lane West,
Bracknell,
Berkshire RG12 7AH UK

Tel : +44 (0)1344 465600
Fax : +44 (0)1344 465626
E : bsria@bsria.co.uk
W : www.bsria.co.uk

Compiled by: Naam : Andrew Freeth Titel : Senior Testingenieur	Approved by: Naam : Mark Roper Titel : Hoofd Testingenieur
---	--

This report must not be reproduced except in full without the written approval of an executive director of BSRIA. It is only intended to be used within the context described in the text.

RAINWATER PENETRATION


MANUFACTURER nv RENSON Sunprotection-Projects sa
 MODEL 412 [mesh 2,3] with drain profile

Date 06/10/2015
 Contract 59126

Simulated rainfall 75 mm/hr
 Wind speed 13.0 m/s

louvre height 986 mm
 louvre width 1000 mm
 louvre area 0,986 m²

VENTILATION RATE		WATER FLOW RATES		Effectiveness	Class
Volume m ³ /s	Velocity m/s	Supply l/u	Penetrated l/u		
0.00	0.00	99.0	0.1	99.9%	A
0.49	0.50	99.0	0.2	99.7%	A
0.99	1.00	99.0	0.6	99.2%	A
1.48	1.50	99.0	3.2	95.6%	B
1.97	2.00	99.0	9.3	87.5%	C
2.47	2.50	99.0	27.3	63.1%	D

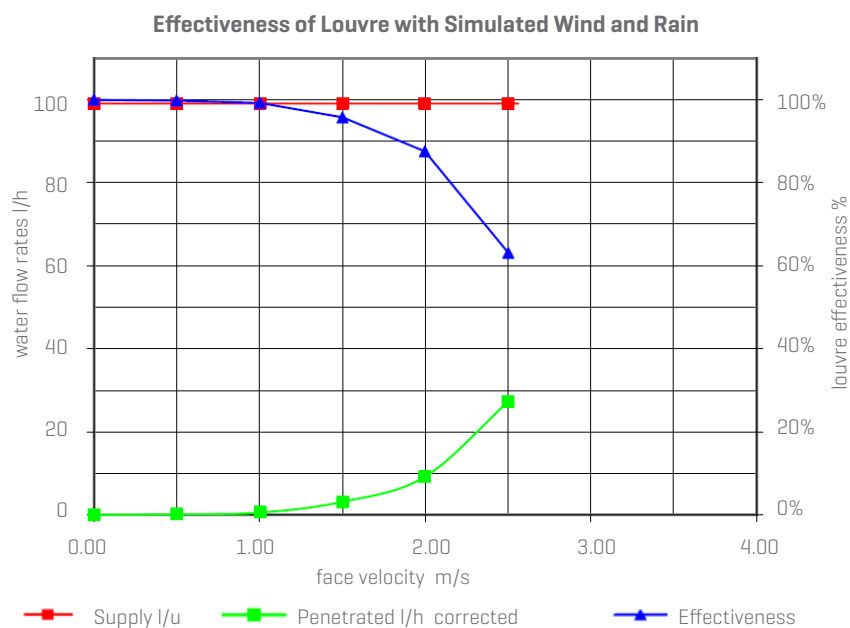

COEFFICIENT OF ENTRY


MANUFACTURER nv RENSON Sunprotection-Projects sa
 MODEL 412 [mesh 2.3 mm] without drain profile

Date 07/10/2015
 Contract 59126


air temperature 16.1 °C
 barometer 997,1 mbar
 air density 1,197 kg/m³

louvre height 986 mm
 louvre width 1000 mm
 louvre area 0,986 m²

	louvre face velocity	air flow rate		
louvre pd Pascal	m/s	Test m ³ /s	theoretical m ³ /s	Coëfficient Ce
8.0	0.61	0.602	3.649	0.165
12.4	0.77	0.756	4.543	0.166
20.2	1.00	0.987	5.799	0.170
32.3	1.27	1.253	7.333	0.171
50.3	1.56	1.541	9.151	0.168
88.0	2.10	2.076	12.103	0.172
150.0	2.74	2.703	15.802	0.171
216.5	3.29	3.250	18.984	0.171
280.0	3.74	3.695	21.590	0.171
308.0	3.93	3.880	22.643	0.171
			mean Ce	0.170
			Class	4

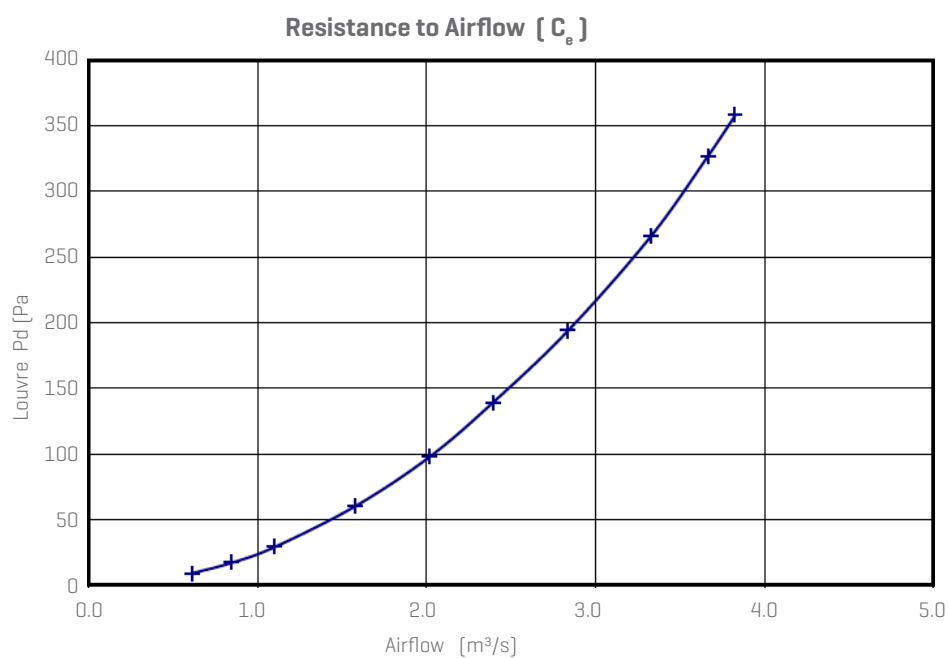

APPENDIX: A MANUFACTURER'S DRAWING

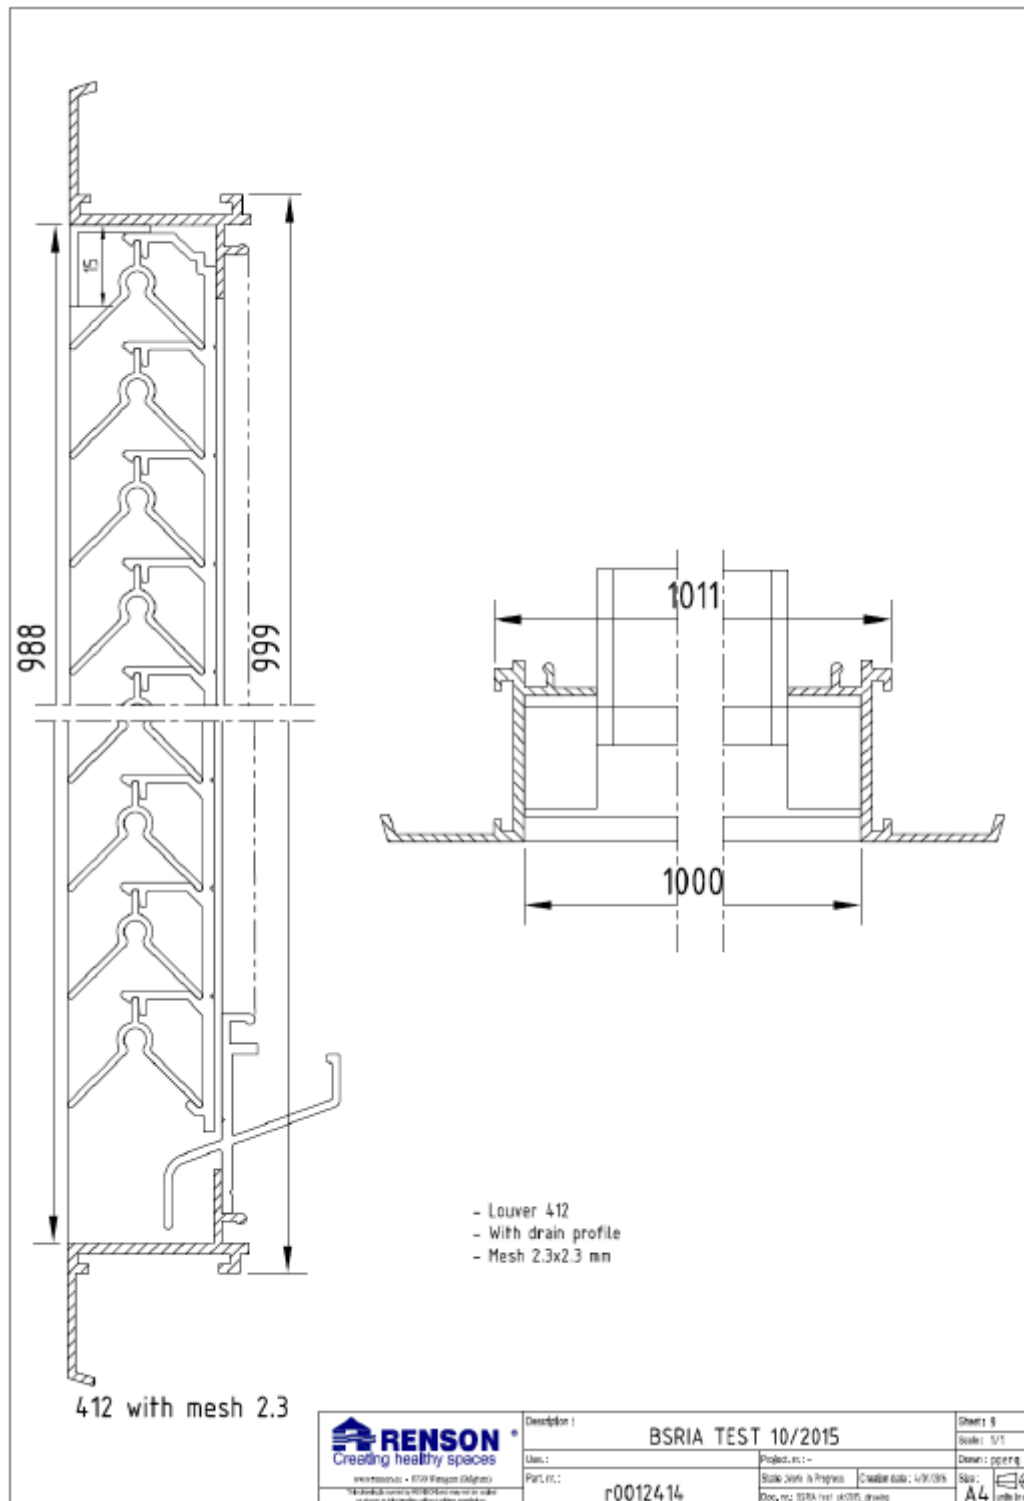

Weather Louvre Test 412 (mesh 2,3) with drain profile

Report 59126/2

Carried out for
nv RENSON Sunprotection-Projects sa

By Andrew Freeth

18 December 2015



Weather Louvre Test 412 (mesh 2,3) with drain profile

Carried out for:

nv RENSON Sunprotection-Projects sa
IZ 2 Vijverdam
Maalbeekstraat 10
B-8790 Waregem
Belgium

Contract: **Report 59126/2**

Date: **18 December 2015**

Issued by: **BSRIA Limited**
Old Bracknell Lane West,
Bracknell,
Berkshire RG12 7AH UK

Telephone: +44 (0)1344 465600

Fax: +44 (0)1344 465626

E: bsria@bsria.co.uk W: www.bsria.co.uk

Compiled by:

Name: Andrew Freeth

Title: Senior Test Engineer

Approved by:

Name: Mark Roper

Title: Principal Test Engineer

This report must not be reproduced except in full without the written approval of an executive director of BSRIA. It is only intended to be used within the context described in the text.

CONTENTS

1	INTRODUCTION.....	5
1.1	Test item information	5
2	TEST METHOD	8
2.1	Water penetration	8
2.2	Pressure drop	8
2.3	Test equipment used	8
3	RESULTS.....	9
3.1	Rainwater Penetration	9
3.2	Coefficient of Entry	10

APPENDICES

APPENDIX: A	MANUFACTURER'S DRAWING.....	11
-------------	-----------------------------	----

FIGURES

Figure 1	Test item 59126A2 (front).....	6
Figure 2	Test item 59126A2 (rear).....	6
Figure 3	Close-up of guard	7

1 INTRODUCTION

This report concerns tests conducted on a louvre to determine the Rainwater Penetration and the Pressure Drop versus Airflow Curve, with the associated Coefficient of Entry using the test methods contained within EN 13030 : 2001. The work was commissioned by nv RENSON Sunprotection-Projects sa and was carried out at BSRIA on 7 – 16 October 2015.

Items received for test

Test Item	BSRIA ID
412 (mesh 2,3) with drain profile	59126A2

1.1 TEST ITEM INFORMATION

Contract	59126
Date	5-10-15
Manufacturer	nv RENSON Sunprotection-Projects sa
Louvre Model	412 (mesh 2,3) with drain profile
Material	Aluminium
Painted	Yes – dark grey
Blade Height	986 mm
Blade Width	1000 mm
Blade Depth	25 mm
Frame Depth	30 mm
No. of Blades	47
Blade Pitch	20 mm
Blade Angle	45° approx.
No. of Banks	2
Guard Type	Insect
Guard Spacing	5 mm
Side Channels	No
Water Drip Tray	Yes
Blade Orientation	Horizontal


Figure 1 Test item 59126A2 (front)



Figure 2 Test item 59126A2 (rear)




Figure 3 Close-up of guard

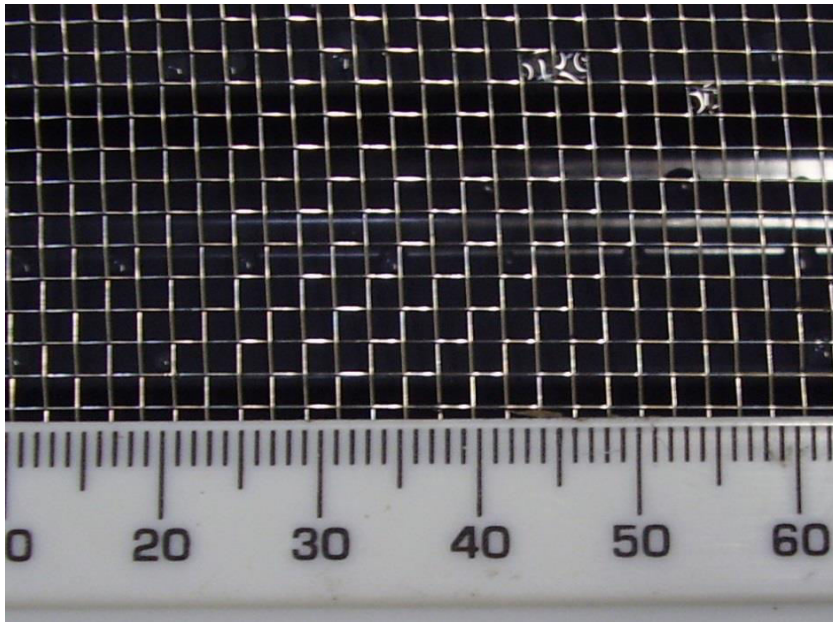

2 TEST METHOD

A schematic representation of the rig used during testing

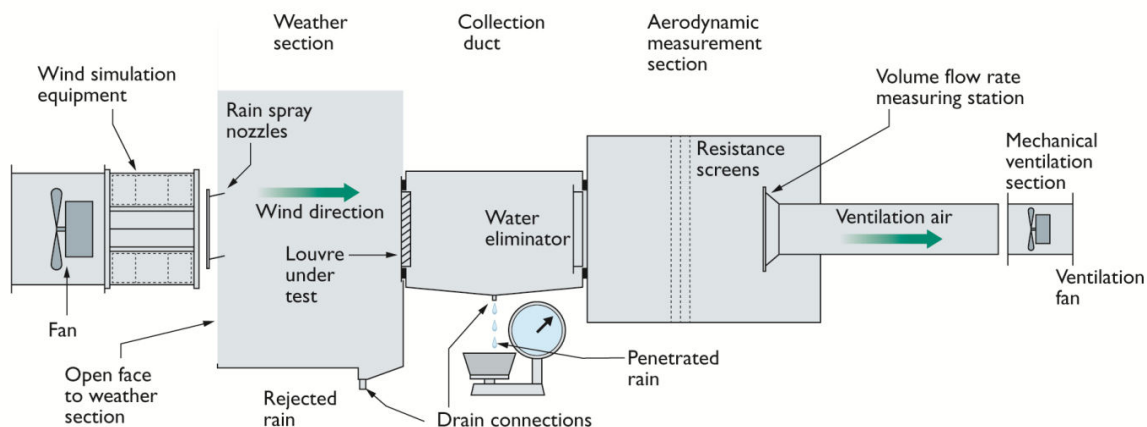

The test comprises of two parts:

2.1 WATER PENETRATION

The weather louvre is subjected to fan driven wind at a speed of 13 m/s and water sprayed as rainfall at a rate of 75 l/h. In addition to the simulated wind and rain, air is drawn through the louvre at various set velocities (0, 0.5, 1.0, 1.5, 2.0, 2.5, 3.0 and 3.5 m/s).

Each test is preceded by a suitable 'pre-test' soak which is typically around 30 minutes. Each test is run until the results become stable, and in any case, for a minimum of 30 minutes.

The penetrated water is collected in the collection duct and is measured and recorded against time elapsed.

A range of measurements are taken to give the characteristic curve for the test louvre.

2.2 PRESSURE DROP

For this test, the Aerodynamic Measuring Section (AMS) is separated from the main rig. The louvre is then mounted in the upstream opening of the AMS.

Pressure tappings in the plenum walls of the AMS allow measurement of the static pressure within the plenum during testing. The airflow volume is calculated from the differential pressure at the measuring cones. The plenum has a set of settling screens within to produce even flow through the cones and therefore gives an accurate reading of the total volume.

By adjusting the fan speed, the total airflow through the system varies and therefore changes the pressure on the louvre under test. A range of measurements are taken to give the characteristic curve for the test louvre.

2.3 TEST EQUIPMENT USED

Test equipment	BSRIA ID	Calibration Expiry Date
Water supply measurement	352	9-1-16
Rain measuring system	353	9-1-16
Airflow cones	364	9-1-16
Micromanometer	5	17-2-16
Micromanometer	682	7-1-16
Scales (water)	332	9-2-16


3 RESULTS

3.1 RAINWATER PENETRATION

MANUFACTURER nv RENSON Sunprotection-Projects sa Date 06/10/2015
 MODEL 412 (mesh 2,3) with drain profile Contract 59126

Simulated rainfall 75 mm/hr louvre height 986 mm
 Wind speed 13.0 m/s louvre width 1000 mm
 louvre area 0.986 m²

VENTILATION RATE		WATER FLOW RATES		Effectiveness	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	99.0	0.1	99.9%	A
0.49	0.50	99.0	0.2	99.7%	A
0.99	1.00	99.0	0.6	99.2%	A
1.48	1.50	99.0	3.2	95.6%	B
1.97	2.00	99.0	9.3	87.5%	C
2.47	2.50	99.0	27.3	63.1%	D

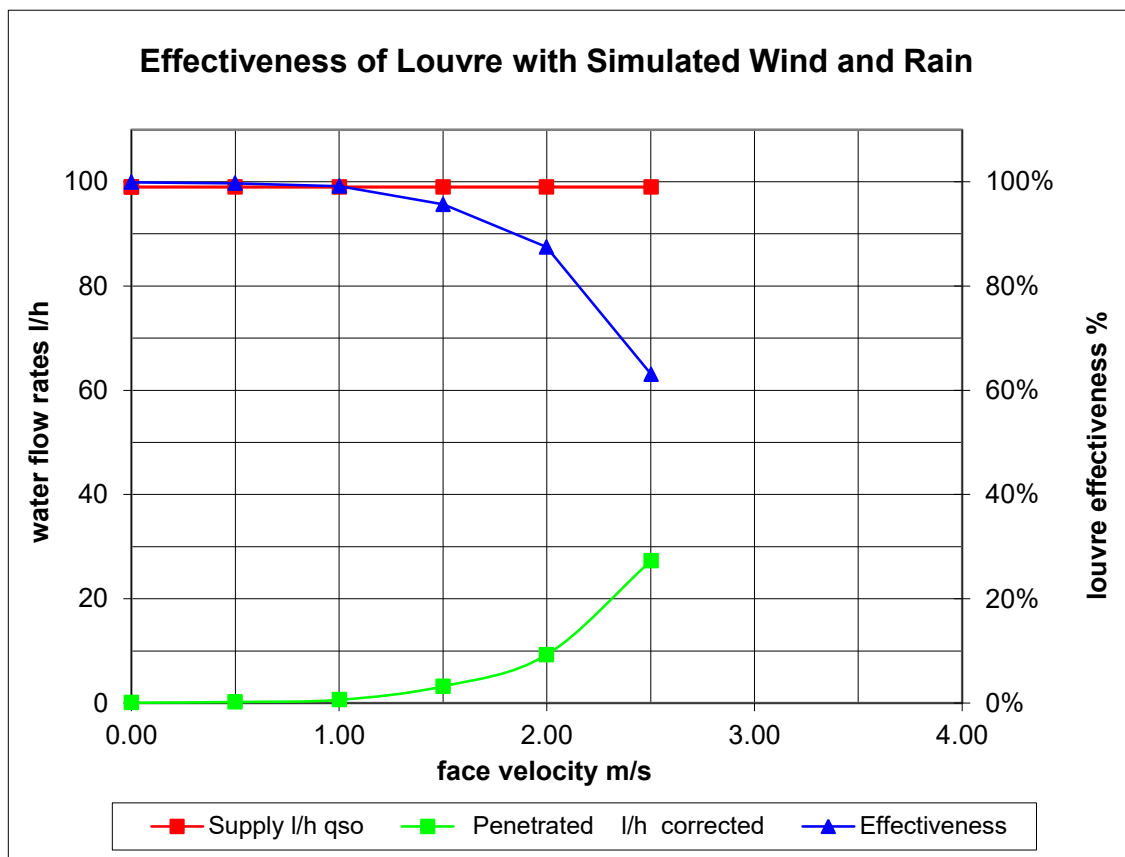

3.2 COEFFICIENT OF ENTRY

MANUFACTURER nv RENSON Sunprotection-Projects sa
MODEL 412 (mesh 2,3) with drain profile


Date 07/10/2015
Contract 59126

air temperature 16.1 °C
barometer 997.9 mbar
air density 1.197 kg/m³

louvre height 986 mm
louvre width 1000 mm
louvre area 0.986 m²

louvre pd Pascals	louvre face velocity	air flow rate		coefficient C _e
	m/s	test m ³ /s	theoretical m ³ /s	
9.0	0.62	0.614	3.823	0.161
17.0	0.86	0.847	5.255	0.161
29.0	1.12	1.101	6.863	0.160
60.0	1.60	1.577	9.872	0.160
97.5	2.04	2.016	12.584	0.160
139.0	2.43	2.392	15.026	0.159
194.0	2.88	2.838	17.751	0.160
266.0	3.38	3.329	20.786	0.160
327.0	3.72	3.666	23.047	0.159
358.0	3.88	3.828	24.114	0.159
mean C _e				0.160
Class				4

Resistance to Airflow (C_e)

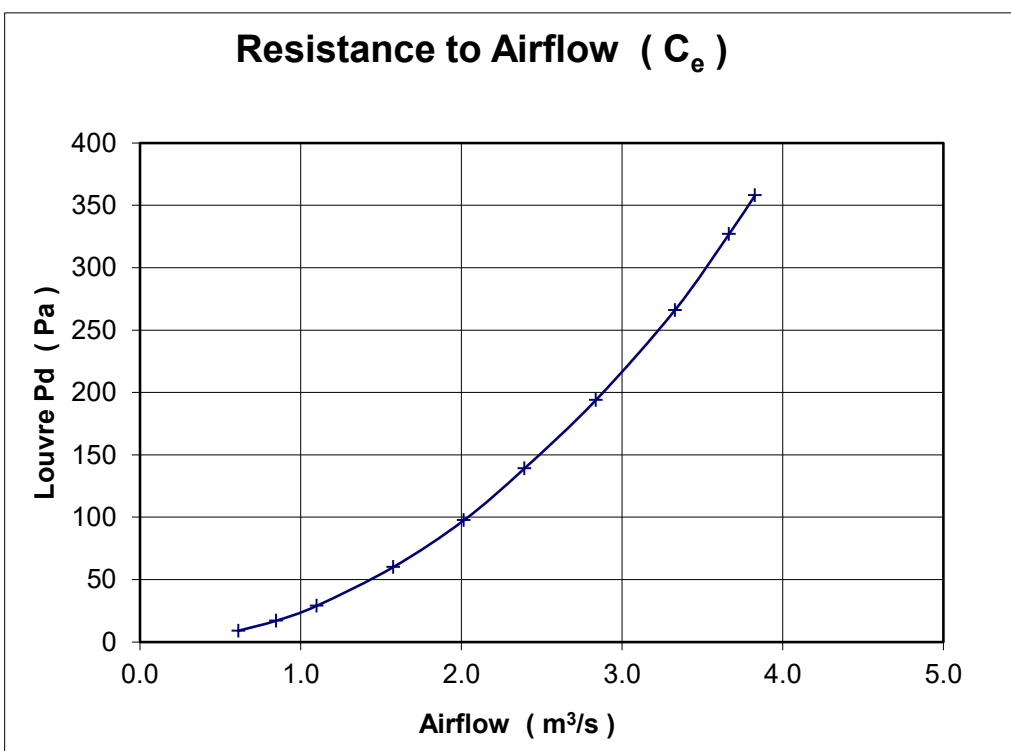

APPENDIX: A MANUFACTURER'S DRAWING

