

Weather Louvre Test

448/225

Carried out for
Renson Ventilation NV

Report 105079/4

Compiled by Thomas Costello

5 June 2023



This page is intentionally left blank

Weather Louvre Test

448/225

Carried out for: Renson Ventilation NV
Industriezone 2, Vijerdam
Maalbeekstraat 6
Waregem
8790
Belgium

Contract: Report 105079/4

Issued by: BSRIA Limited
Old Bracknell Lane West
Bracknell
Berkshire
RG12 7AH
UK

Telephone: +44 (0)1344 465600

Fax: +44 (0)1344 465626

Email: bsria@bsria.co.uk

Website: www.bsria.co.uk

QUALITY ASSURANCE

Issue	Date	Compiled by:	Approved by:	Signature
-------	------	--------------	--------------	-----------

FINAL	05-Jun-2023	Thomas Costello	Anthony Collier	
-------	-------------	-----------------	-----------------	--



Senior Technician	Technical Operations Manager
-------------------	------------------------------------

DISCLAIMER

This Document must not be reproduced except in full without the written approval of an executive director of BSRIA. It is only intended to be used within the context described in the text.

This Document has been prepared by BSRIA Limited, with reasonable skill, care and diligence in accordance with BSRIA's Quality Assurance and within the scope of our Terms and Conditions of Business.

This Document is confidential to the client and we accept no responsibility of whatsoever nature to third parties to whom this report, or any part thereof, is made known. Any such party relies on the Document at its own risk.

CONTENTS

1	INTRODUCTION.....	5
1.1	Test Item Information	5
2	TEST METHOD	8
2.1	Water Penetration.....	8
2.2	Pressure Drop.....	8
2.3	Test equipment used.....	8
3	RESULTS	9
3.1	Rainwater Penetration	9
3.2	Coefficient of Entry.....	10
3.3	Coefficient of Discharge	11

FIGURES

Figure 1	Test item 105079A4 (front)	6
Figure 2	Test item 105079A4 (rear)	6
Figure 3	Test item 105079A4 (close-up of guard)	7

APPENDICES

APPENDIX A:	Manufacturer's Drawing	12
-------------	------------------------------	----

1 INTRODUCTION

This report concerns tests conducted on a louvre to determine the Rainwater Penetration and the Pressure Drop versus Airflow Curves, with the associated Coefficient of Entry and Coefficient of Discharge, using the test methods contained within BS EN 13030:2001. It should be noted that BS EN 13030:2001 simply provides a method for testing and rating louvre samples, there are no minimum permitted values or recommendations for louvre performance.

The work was commissioned by Renson Ventilation NV and was carried out at BSRIA North from 18th May to 19th May 2023, by Thomas Costello and Samuel Twibill of BSRIA Ltd.

Items received for test

Test Item	BSRIA ID
448/225	105079A4


1.1 TEST ITEM INFORMATION

Contract	105079
Date	1/5/23
Manufacturer	Renson Ventilation NV
Louvre Model	448/225
Material	Aluminium
Painted	No
Core Area Height	973 mm
Core Area Width	973 mm
Blade Pack Depth	230 mm
Frame Depth	220 mm
No. of Blades	5
Blade Pitch	150 mm
Blade Angle	45° approx.
No. of Banks	1
Guard Type	Insect
Guard Spacing	10 mm
Side Channels	No
Water Drip Tray	No
Blade Orientation	Horizontal

Note: Weather louvre core area - product of the minimum height H and minimum width W of the front opening in the weather louvre assembly with the louvre blades removed.
Blade Pack Depth refers to the distance from front of first bank to rear of last bank.


Figure 1 Test item 105079A4 (front)**Figure 2 Test item 105079A4 (rear)**

Figure 3 Test item 105079A4 (close-up of guard)

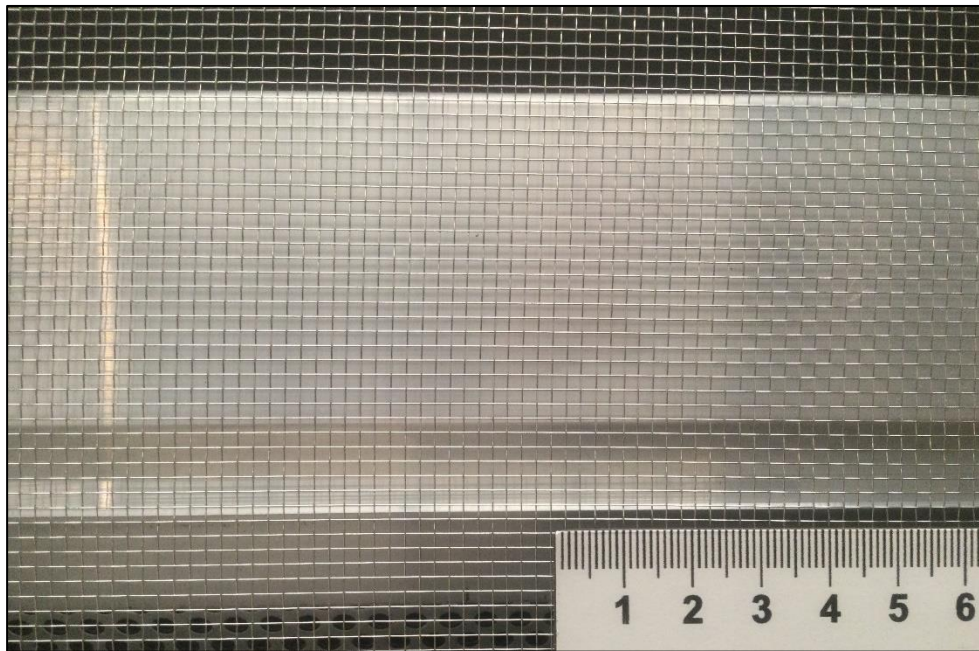

2 TEST METHOD

A schematic representation of the rig used during testing

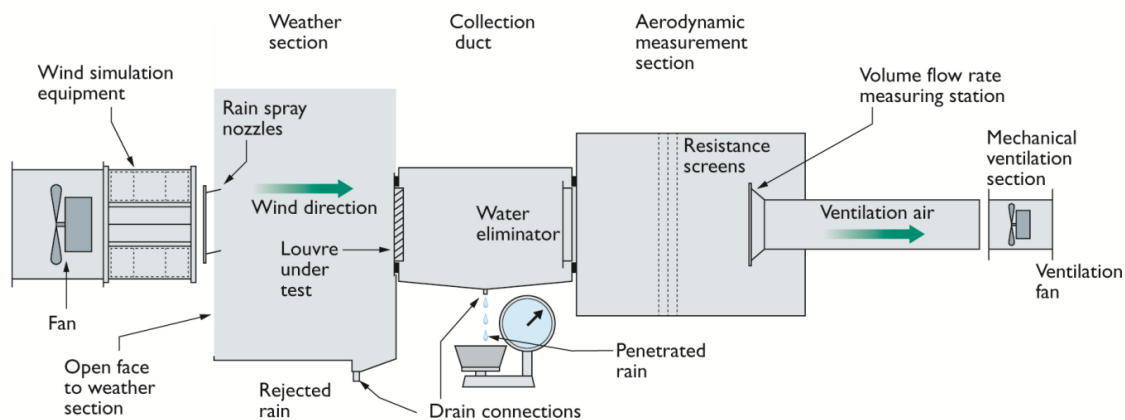

The test comprises of two parts:

2.1 WATER PENETRATION

The weather louvre is subjected to fan driven wind at a speed of 13 m/s and water sprayed as rainfall at a rate of 75 l/h (+10% / -0%). In addition to the simulated wind and rain, air is drawn through the louvre at various set velocities (0, 0.5, 1.0, 1.5, 2.0, 2.5, 3.0 and 3.5 m/s).

Each test is preceded by a suitable 'pre-test' soak which is typically around 30 minutes. Each test is run until the results become stable, and in any case, for a minimum of 30 minutes.

The penetrated water is collected in the collection duct and is measured and recorded against time elapsed. A range of measurements are taken to give the characteristic curve for the test louvre.

2.2 PRESSURE DROP

For this test, the Aerodynamic Measuring Section (AMS) is separated from the main rig. The louvre is then mounted in the upstream opening of the AMS.

Pressure tapings in the plenum walls of the AMS allow measurement of the static pressure within the plenum during testing. The airflow volume is calculated from the differential pressure at the measuring cones. The plenum has a set of settling screens within to produce even flow through the cones and therefore gives an accurate reading of the total volume.

By adjusting the fan speed, the total airflow through the system varies and therefore changes the pressure on the louvre under test. A range of measurements are taken to give the characteristic curve for the test louvre.

2.3 TEST EQUIPMENT USED

Test equipment	BSRIA ID	Calibration Expiry Date
Rain measuring system	353	19-12-23
Airflow cones	364	18-12-23
Fan	484	19-12-23
Scales (water)	1599	12-05-24
Micromanometer	1600	24-11-23
Micromanometer	1601	24-11-23
Temperature and Pressure Gauge	1605	10-10-23
Flow meter	1533	05-06-23
Water supply measurement	1749	20-12-23

3 RESULTS

3.1 RAINWATER PENETRATION

Manufacturer Renson Ventilation NV


Date 19/05/2023

Model 448/225

Contract 105079

Simulated Rainfall	75 (+10% / -0%)	mm/hr	Core Area Height	973	mm
Wind Speed	13 (+/-10%)	m/s	Core Area Width	973	mm
			Core Area Area	0.947	m ²

Ventilation Rate		Water Flow Rates		Effectiveness %	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	97.2	4.1	94.8	C
0.47	0.50	97.2	10.7	86.2	C
0.95	1.00	97.2	16.5	78.8	D
1.42	1.50	97.2	24.0	69.1	D
1.89	2.00	97.2	33.8	56.7	D
2.37	2.50	97.2	49.1	37.0	D
2.84	3.00	97.2	64.7	17.6	D
3.31	3.50	97.2	66.7	14.5	D

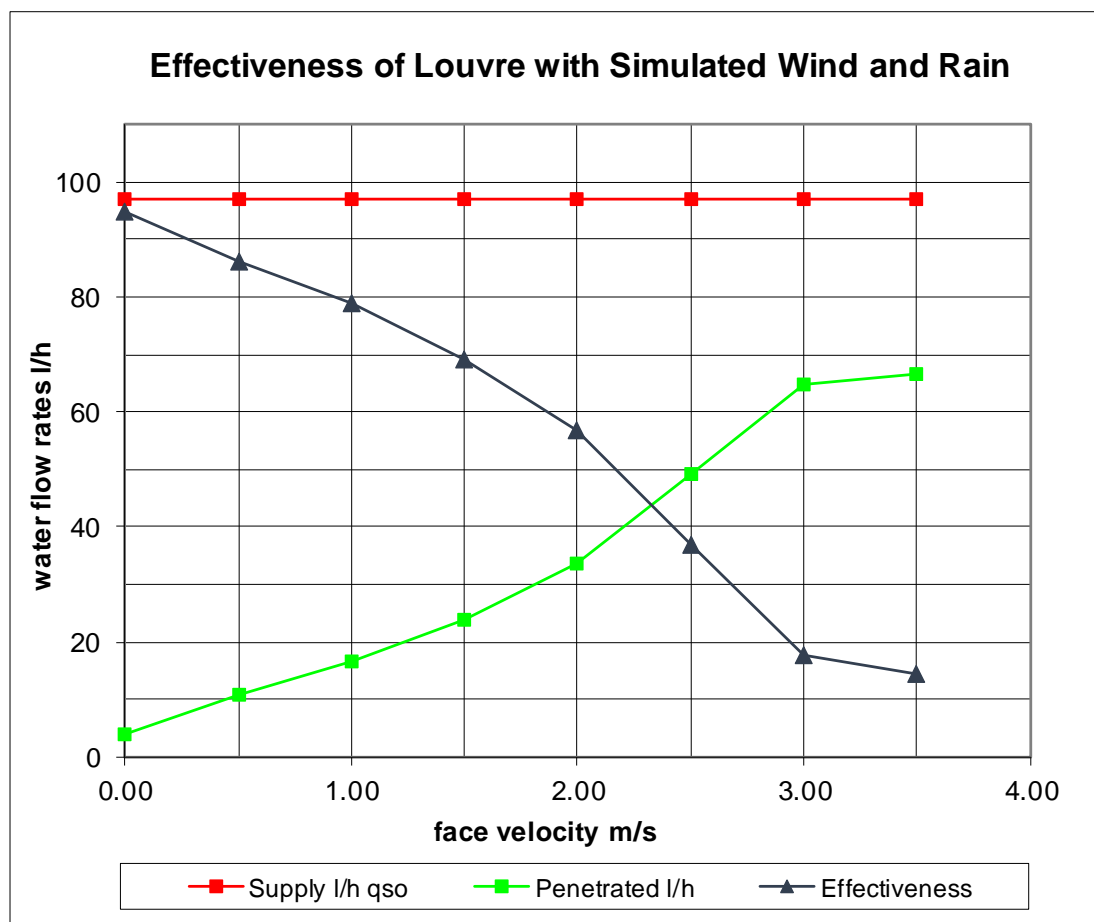


3.2 COEFFICIENT OF ENTRY

Manufacturer Renson Ventilation NV
Model 448/225

Date 18/05/2023
Contract 105079

Air Temperature	16.9 °C	Core Area Height	973 mm
Barometer	1022.7 mbar	Core Area Width	973 mm
Air Density	1.223 kg/m ³	Core Area Area	0.947 m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _e
	m/s	Test m ³ /s	Theoretical m ³ /s	
10.0	0.89	0.839	3.828	0.219
21.7	1.32	1.249	5.639	0.221
43.8	1.87	1.773	8.011	0.221
64.2	2.28	2.162	9.699	0.223
85.6	2.64	2.498	11.199	0.223
111.0	3.00	2.845	12.753	0.223
137.0	3.34	3.162	14.168	0.223
163.0	3.64	3.446	15.454	0.223
189.0	3.92	3.708	16.641	0.223
213.0	4.17	3.945	17.666	0.223
Mean C _e				0.222
Class				3

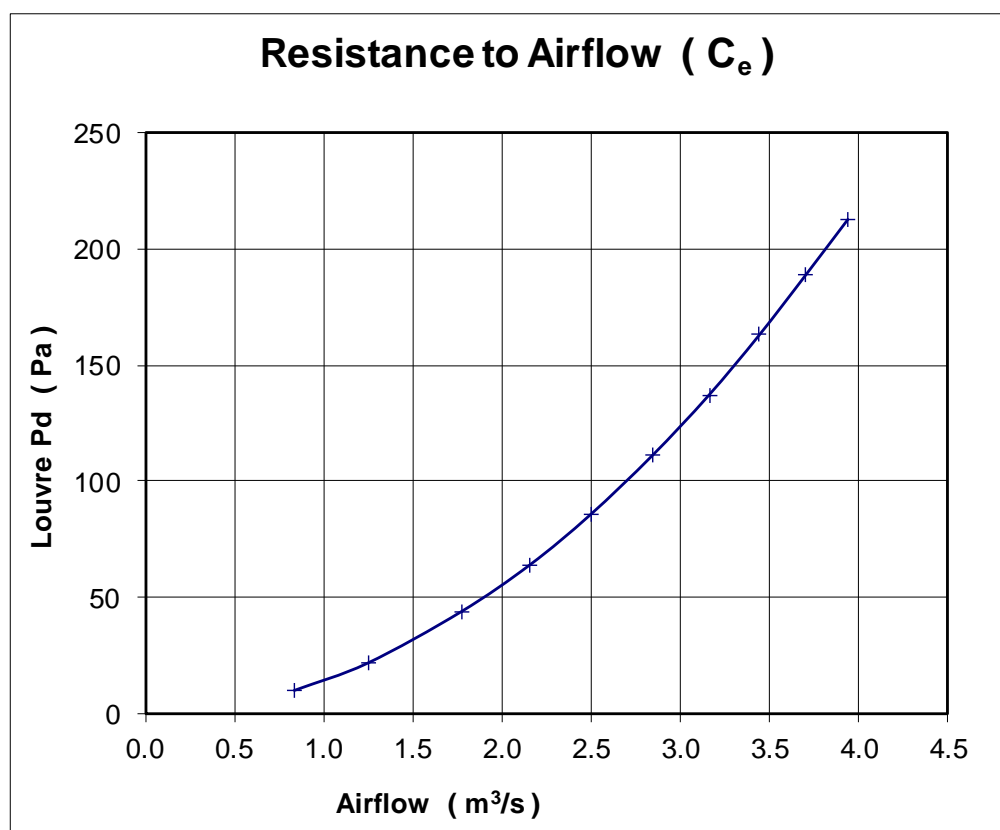

A 'trendline' for the above graph would follow $y = 14.055x^{1.9788}$


3.3 COEFFICIENT OF DISCHARGE

Manufacturer Renson Ventilation NV
Model 448/225

Date 18/05/2023
Contract 105079

Air Temperature	17.9	°C	Core Area Height	973	mm
Barometer	1022.5	mbar	Core Area Width	973	mm
Air Density	1.219	kg/m ³	Core Area Area	0.947	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _d
	m/s	Test m ³ /s	Theoretical m ³ /s	
10.0	0.84	0.793	3.835	0.207
24.7	1.32	1.246	6.027	0.207
49.3	1.87	1.767	8.515	0.208
73.7	2.29	2.166	10.411	0.208
98.1	2.64	2.503	12.011	0.208
122.0	2.95	2.794	13.394	0.209
147.0	3.24	3.067	14.703	0.209
175.0	3.55	3.360	16.042	0.209
204.0	3.84	3.634	17.320	0.210
236.0	4.13	3.912	18.629	0.210
Mean C _d				0.208
Class				3

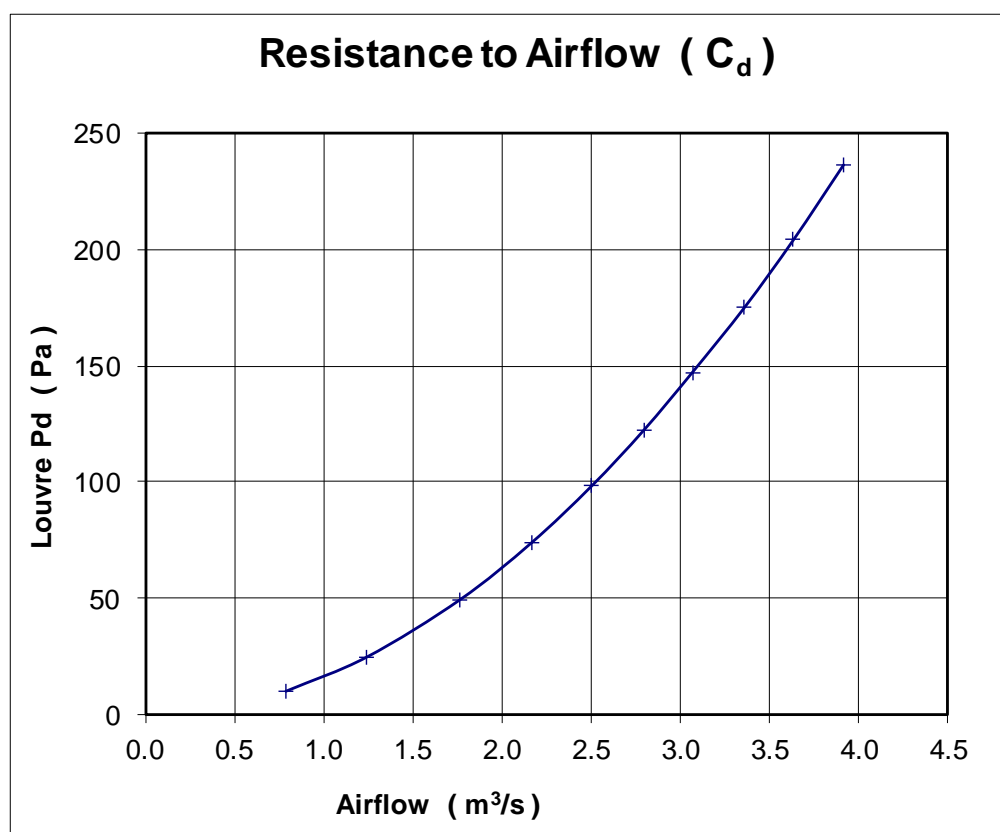

A 'trendline' for the above graph would follow $y = 15.921x^{1.9798}$

APPENDIX A: MANUFACTURER’S DRAWING

