

# Evidence of Performance

Airborne sound insulation of building elements



Test report 164 43337e

This test report is a translation of test report 164 43337 dated 26th April 2010

Client **Renson Ventilation NV**  
Industriezone 2 Vijverdam Maalbeekstraat 10  
  
8790 Waregem  
Belgium

#### Basis

EN ISO 140-1:1997+A1:2004  
EN 20140-3 :1995+A1:2004  
EN ISO 717-1 : 1996+A1:2006

Product	Ventilation grille with sound-absorbing slats
System designation	Type 447/225 (L.170ACL)
Dimensions (w x h)	1230 mm x 1480 mm
Material	Aluminium
Orientation	Sound-absorbing slats facing noise side
Special features	-/-

#### Representation



#### Instructions for use

This test report serves to demonstrate the sound insulation of a building element.

Weighted sound reduction index  $R_w$   
Spectrum adaptation terms C and  $C_{tr}$



$$R_w (C; C_{tr}) = 13 (-1; -3) \text{ dB}$$

#### Validity

The data and results given relate solely to the tested and described specimen.

Testing the sound insulation does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

#### Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

The cover sheet can be used as abstract.

#### Contents

The test report contains a total of 7 pages:

- 1 Object
  - 2 Procedure
  - 3 Detailed results
- Data sheet (1 page)

ift Rosenheim  
26. April 2010

Dr. Joachim Hessinger, Dipl.-Phys.  
Prüfstellenleiter  
ift Schallschutzzentrum

Bernd Saß, Dipl.-Ing. (FH)  
Stv. Prüfstellenleiter  
ift Schallschutzzentrum



LSW - Labor für Schall- und Wärmemesstechnik GmbH  
- das Schallschutzprüfzentrum des ift Rosenheim

Geschäftsführer:  
Dr. Jochen Peichl  
Ulrich Sieberath

Lackermannweg 26  
D-83071 Stephanskirchen

Tel. +49 (0)8031/261-2250  
Fax: +49 (0)8031/261-2508  
www.lsw-gmbh.de

Sitz: 83026 Rosenheim  
AG Traunstein, HRB 14822

Sparkasse Rosenheim  
Kto. 500 434 626  
BLZ 711 500 00

Notified Body Nr.: 0757  
Anerkannte PUZ-Stelle: BAY 18

Sachverständige Prüfstelle Gruppe I  
für Eignungs- und Güteprüfung DIN 4109

## 1 Object

### 1.1 Description of test specimen

<b>Product</b>	Ventilation grille with sound-absorbing slats
Product designation	Type 447/225 (L.170ACL)
Orientation	Sound-absorbing slats facing noise side
Mass of the element	49,0 kg
Area related mass	26,9 kg/m <sup>2</sup>
Dimensions (w x h)	1230 mm × 1480 mm
Total thickness	225 mm
Material	Aluminium-sheet 1,5 mm
<b>Slats</b>	59,5% " free air transfer "
Type	L.170 ACL
Number	8 with 7 openings
Configuration	Aluminium sheet slats, filled with mineral fibre, bottom side with perforated sheet
Total thickness of slats	45 mm
Free slat spacing	64 mm
Slat spacing - elevation	170 mm

The description is based on inspection of the test specimen at the **ift** Centre for Acoustics. Item designations / numbers as well as material specifications have been provided by the client. (Further manufacturer data are marked with \*)

### 1.2 Mounting in test rig

Test rig	Window test rig with suppressed flanking transmission acc. to EN ISO 140-1; the test rig includes a 5 cm continuous acoustic break which is sealed in the test opening with plastic sealant.
Mounting of specimen	Specimen mounted by <b>ift</b> Centre for Acoustics
Mounting conditions	Mounting in test opening, connecting joints filled with foam and sealed on both sides by application of elastic sealant.
Mounting position	externally flush in test opening
Orientation	absorbing reveal towards source room side (noise side).
Preparation	no special preparation required

### 1.3 Representation of the test specimen

The structural details were examined solely on the basis of the characteristics to be classified. Illustrations are based on unchanged documentation provided by the client.

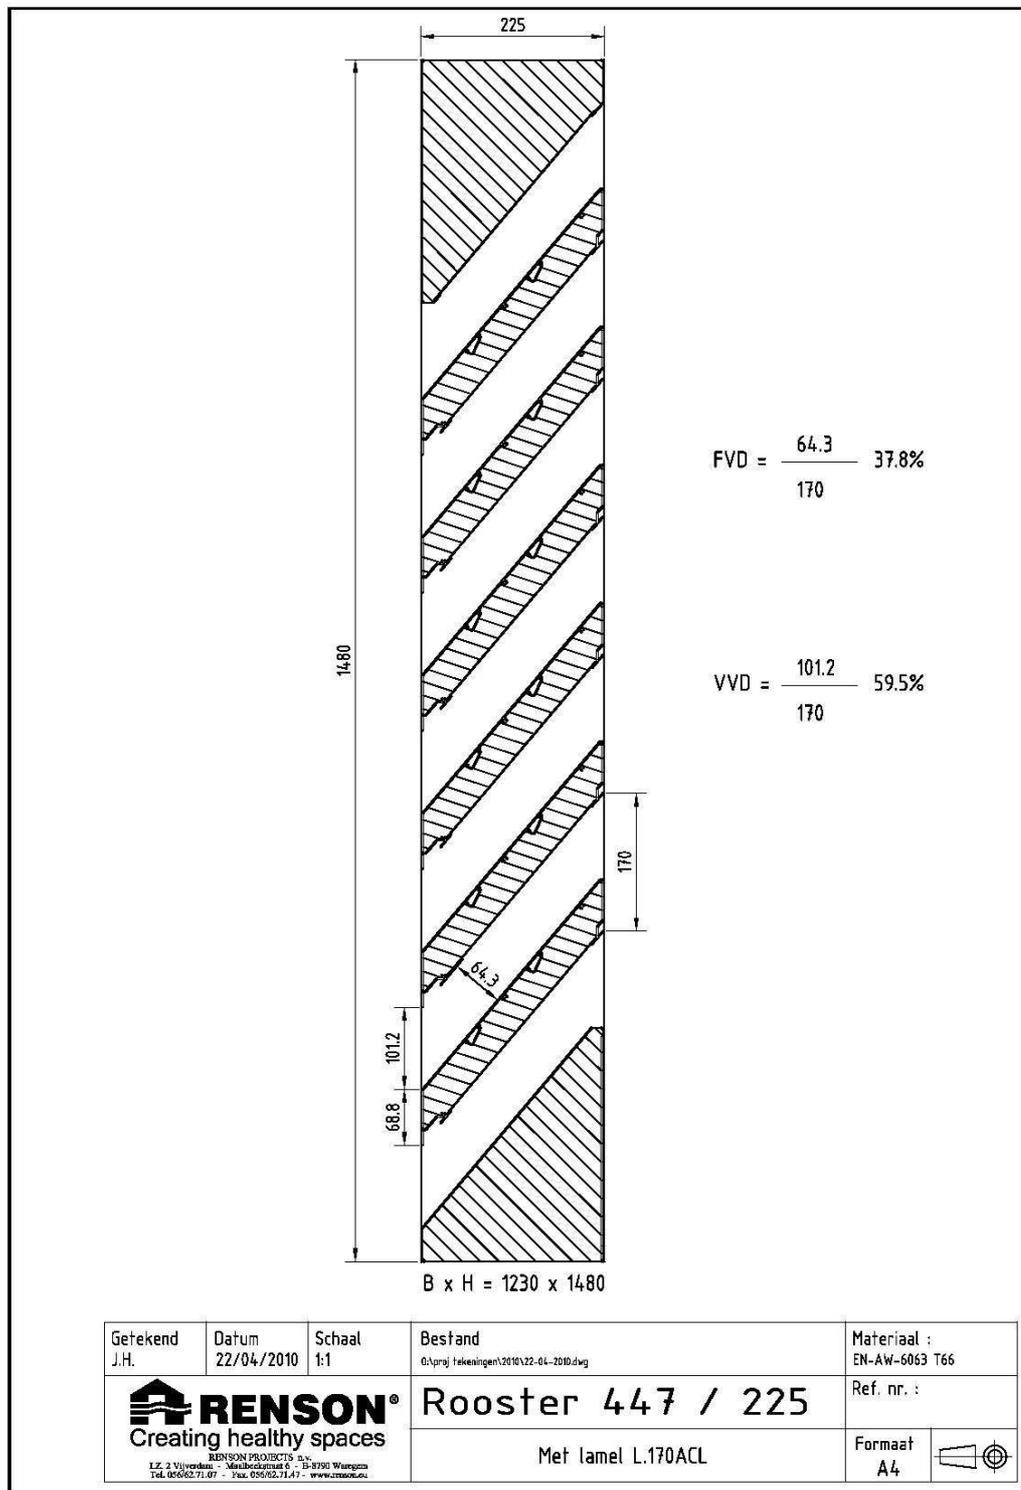


Fig. 1 Vertical cross-section



Receiving room side



Source room side

**Fig. 2** Photography of the mounted element, taken by ift Centre for Acoustics

## 2 Procedure

### 2.1 Sampling

Sampling	The samples were selected by the client.
Quantity	1
Manufacturer	Renson B.V.
Factory	Renson B.V.
Date of manufacture / date of sampling*	25 March 2010
Production line	Renson B.V.
Delivered to ift	16. April 2010 by client via forwarding agency
ift registration number	27971/1

### 2.2 Process

#### Basis

EN ISO 140-1:1997 + A1:2004 Acoustics; Measurement of sound insulation in buildings and of building elements - Part 1: Requirements for laboratory test facilities with suppressed flanking transmission



EN 20140-3:1995 + A1:2004 Acoustics; Measurement of sound insulation in buildings and of building elements - Part 3: Laboratory measurements of airborne sound insulation of building elements

EN ISO 717-1 : 1996 + A1:2006 Acoustics; Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation

Corresponds to the national German versions:

DIN EN ISO 140-1:2005-03, DIN EN ISO 140-3:2005-03 und DIN EN ISO 717-1 : 2006-11

Boundary conditions	as per standard specifications
Deviation	There have been no deviations from the test method and test conditions, respectively
Test noise	Pink noise
Measuring filter	one-third-octave band filter
Test limits	
Measurement limits	
Background noise level	The background noise level in the receiving room was determined during measurement and the receiving room level $L_2$ corrected by calculation as per DIN EN 20140-3:1995 + A1:2004 clause 6.5.
Maximum sound insulation	The Maximum sound insulation of the test rig is at least 15 dB higher than the measured sound reduction index of the test specimen. Not corrected by calculation.
Measurement of reverberation time	arithmetical mean: two measurements each of 2 loudspeaker and 3 microphone positions (total of 12 independent measurements).
Measurement equation A	$A = 0,16 \cdot \frac{V}{T} \text{ m}^2$
Measurement of sound level difference	Minimum of 2 loudspeaker positions and rotating microphones.
Measurement equation	$R = L_1 - L_2 + 10 \cdot \lg \frac{S}{A} \text{ dB}$

Key

A	equivalent absorption area in $\text{m}^2$
$L_1$	Sound pressure level source room in dB
$L_2$	Sound pressure level receiving room in dB
R	Sound reduction index in dB
T	Reverberation time in s
V	Volume of receiving room in $\text{m}^3$
S	Test surface of specimen in $\text{m}^2$

### 2.3 Measuring and test equipment

Device	Type	Manufacturer
Integrating sound meter	Typ Nortronic 840	Fa. Norsonic-Tippkemper
Microphone preamplifiers	Typ 1201	Fa. Norsonic-Tippkemper
Microphone unit	Typ 1220	Fa. Norsonic-Tippkemper
Calibrator	Typ 1251	Fa. Norsonic-Tippkemper
Dodecahedron loudspeakers	Typ 229, 96 Ohm	Fa. Norsonic-Tippkemper
Amplifier	Typ 235, 100 W	Fa. Norsonic-Tippkemper
Rotating microphone boom	Typ 231-N-360	Fa. Norsonic-Tippkemper

The ift Centre for Acoustics participates in comparative measurements at the Physikalisch-Technische Bundesanstalt (PTB) in Braunschweig every three years, the last one was in April 2010. The sound level meter used, Series No. 17848 was calibrated by the Dortmund Eichamt (calibration agency) on 22 January 2009. The calibration is valid until 31 December 2011.

### 2.4 Testing

Date	20 <sup>th</sup> April 2010
Test engineer	Bernd Saß

## 3 Detailed results

The values of the measured sound reduction index of the tested element are plotted as a function of frequency in the annexed data sheet and tabled.

As per EN ISO 717-1 the weighted sound reduction index  $R_w$  and the spectrum adaptation terms  $C$  and  $C_{tr}$  for the frequency range from 100 Hz to 3150 Hz obtained by calculation are as follows:

$$R_w (C; C_{tr}) = 13 (-1; -3) \text{ dB}$$

According to EN ISO 717-1 the following additional spectrum adaptation terms are obtained:

$$\begin{array}{lll}
 C_{50-3150} = -1 \text{ dB} & C_{100-5000} = 0 \text{ dB} & C_{50-5000} = 0 \text{ dB} \\
 C_{tr,50-3150} = -3 \text{ dB} & C_{tr,100-5000} = -3 \text{ dB} & C_{tr,50-5000} = -3 \text{ dB}
 \end{array}$$

Upon request by the client and in deviation from the evaluation method as per EN ISO 717-1, the weighted sound reduction index  $R_w$  was additionally evaluated in steps of 1/10- dB; the result obtained from the 1/10 dB steps is marked with an \* and is:

$$R_w^* = 13,6 \text{ dB}$$

ift Rosenheim  
Centre for Acoustics  
26. April 2010

# Sound reduction index according to ISO 140 - 3

Laboratory measurement of airborne sound insulation of building elements



Client: Renson Ventilation NV, B-8790 Waregem


System designation Type 447/225 (L.170ACL)

## Design of test specimen

Ventilation grille with sound-absorbing slats  
 Overall dimensions 1230 mm × 1480 mm  
 Total thickness 225 mm  
 Area related mass 26.9 kg/m<sup>2</sup>  
 Material Aluminium  
 Orientation Sound-absorbing slats facing noise side

Test date 20th April 2010  
 Test surface S 1.25 m × 1.50 m = 1.88 m<sup>2</sup>  
 Test rig as per EN ISO 140-1  
 Partition wall Double-leaf concrete wall  
 Test noise pink noise  
 Volumes of test rooms V<sub>S</sub> = 109.9 m<sup>3</sup>  
 V<sub>E</sub> = 101.3 m<sup>3</sup>  
 Maximum sound reduction index  
 R<sub>w,max</sub> = 62 dB (related to test surface)  
 Mounting conditions  
 Element externally flush-mounted in test opening and fixed by wedges. Connecting joints filled with foam and sealed with elastic sealants on both sides  
 Climate in test rooms 20 °C / 40 % RF

f in Hz	R in dB
50	18.3
63	13.6
80	11.7
100	8.5
125	10.1
160	5.8
200	3.9
250	4.6
315	5.1
400	5.7
500	7.8
630	10.2
800	13.0
1000	15.4
1250	17.6
1600	18.8
2000	17.8
2500	16.0
3150	14.8
4000	13.7
5000	13.8

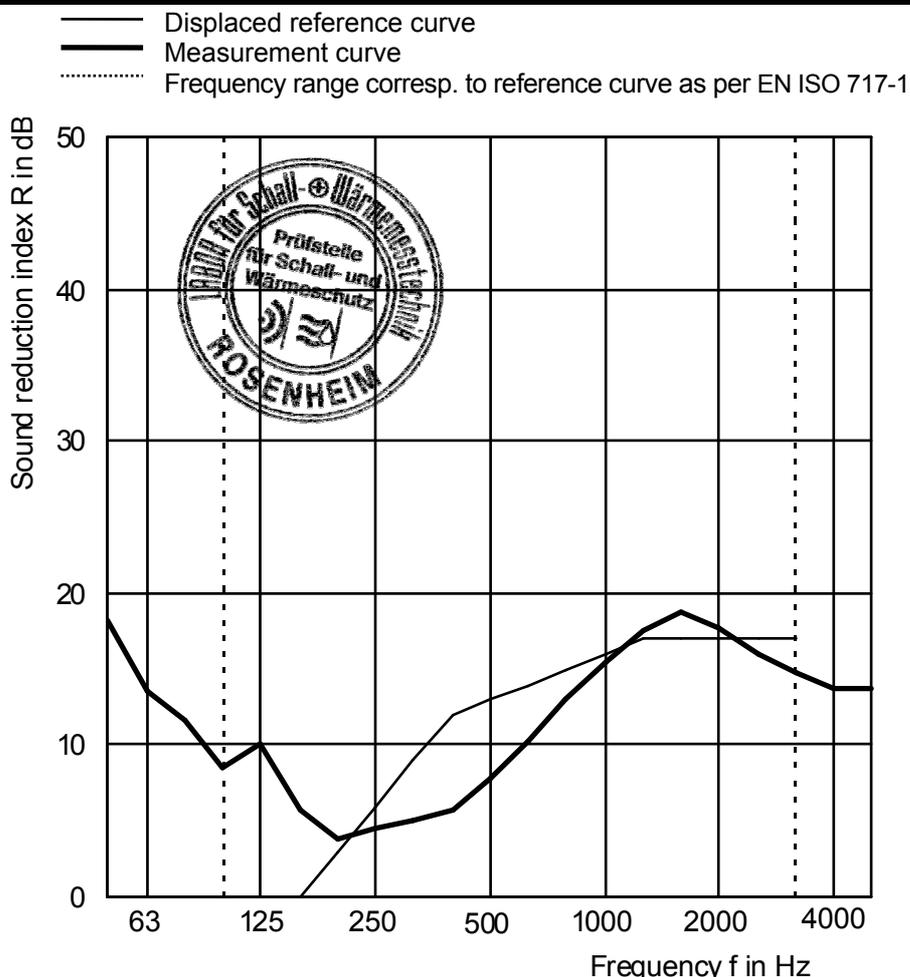

Rating according to EN ISO 717-1 (in third octave bands):

**R<sub>w</sub> (C;C<sub>tr</sub>) = 13 (-1;-3) dB**  
 C<sub>50-3150</sub> = -1 dB; C<sub>100-5000</sub> = 0 dB; C<sub>50-5000</sub> = 0 dB  
 C<sub>tr,50-3150</sub> = -3 dB; C<sub>tr,100-5000</sub> = -3 dB; C<sub>tr,50-5000</sub> = -3 dB

Test report No.: 164 43337e, page 7 of 7

ift Rosenheim  
 Centre for Acoustics  
 26. April 2010

*J. Hessinger*  
 Dr. Joachim Hessinger, Dipl.-Phys.  
 Prüfstellenleiter